


Health and Safety rules for visitors

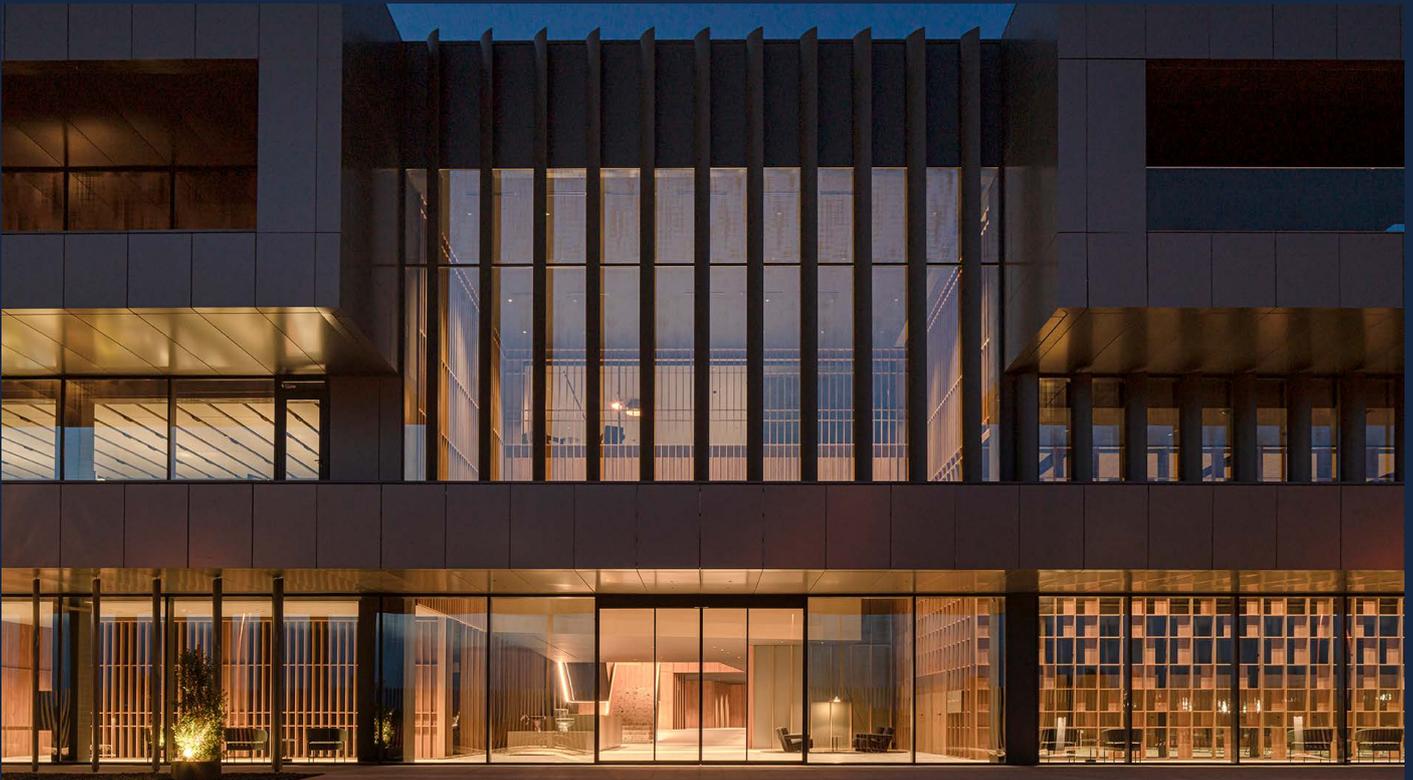

Health and Safety rules for visitors

WHAT TO DO IN CASE OF EMERGENCY?

- 1** If you detect an emergency (accident, fire, spill, or any unusual situation), inform any Power Electronics Group personnel and remain calm.
- 2** If any alarm sounds (emergency alarm), wait in position and stay alert.
- 3** If the evacuation alarm sounds a second time: stay calm, locate the nearest emergency exit, proceed to the Main Access Gate, and wait until the emergency situation is over.

Welcome to Power Electronics. We invite you to join our “Zero Accidents” vision, applicable to anyone working at or visiting any of our facilities. On our corporate website, you can find our “Health and Safety Policy,” the “Stop Work Policy” in the event of serious or imminent risks, and the “Zero Tolerance Policy” regarding alcohol or drug consumption in our facilities or where any of our activities are being carried out.


Thank you in advance for helping us maintain our commitments. We encourage you to share any opportunities for improving our system by emailing us at: seguridadysalud@power-electronics.com

Mandatory rules

According to P14.010S-F32 REV. A25

- **ENTER AND EXIT THE FACILITIES ONLY THROUGH THE MAIN GATE.**
Do not forget to inform the guard when you leave.
- **YOUR CONTACT WILL HAVE TO ACCOMPANY YOU THROUGHOUT YOUR ENTIRE STAY.**
- **WEAR SAFETY SHOES AND A VEST IF YOU ENTER THE PLANT.** If you don't have, request toe caps and a visitor vest at the entrance and return them before you leave.
- **USE PERSONAL PROTECTIVE EQUIPMENT IF APPROACHING ANY PRODUCTION LINE.** It is indicated on the workstation sheet; ask if you cannot find it or do not have PPE.
- **BE AWARE OF VEHICLE TRAFFIC IN THE PLANT.** Keep a safe distance from industrial vehicles and ensure you are not nearby. Walk only on pedestrian paths and use marked crossings. Help improve forklift flow and give way to vehicles by signaling with your hand.
- **KEEP A SAFE DISTANCE FROM ELEVATED LOADS AND DO NOT STAY NEAR THEM.**
- **ACCESS TO TEST AREAS IS FORBIDDEN WITHOUT AUTHORIZATION.**
- **SMOKING IS FORBIDDEN IN THE FACILITIES.**
- **COLLABORATE WITH WASTE SEPARATION.**
Each bin indicates the type of waste it can contain.
- **DO NOT DUMP TOXIC SUBSTANCES INTO THE PLANT'S SANITATION SYSTEM.**
- **ACCESS TO THE PLANT IN SHORTS, DRESSES, OR SKIRTS IS NOT ALLOWED.**

Power Electronics evacuation map

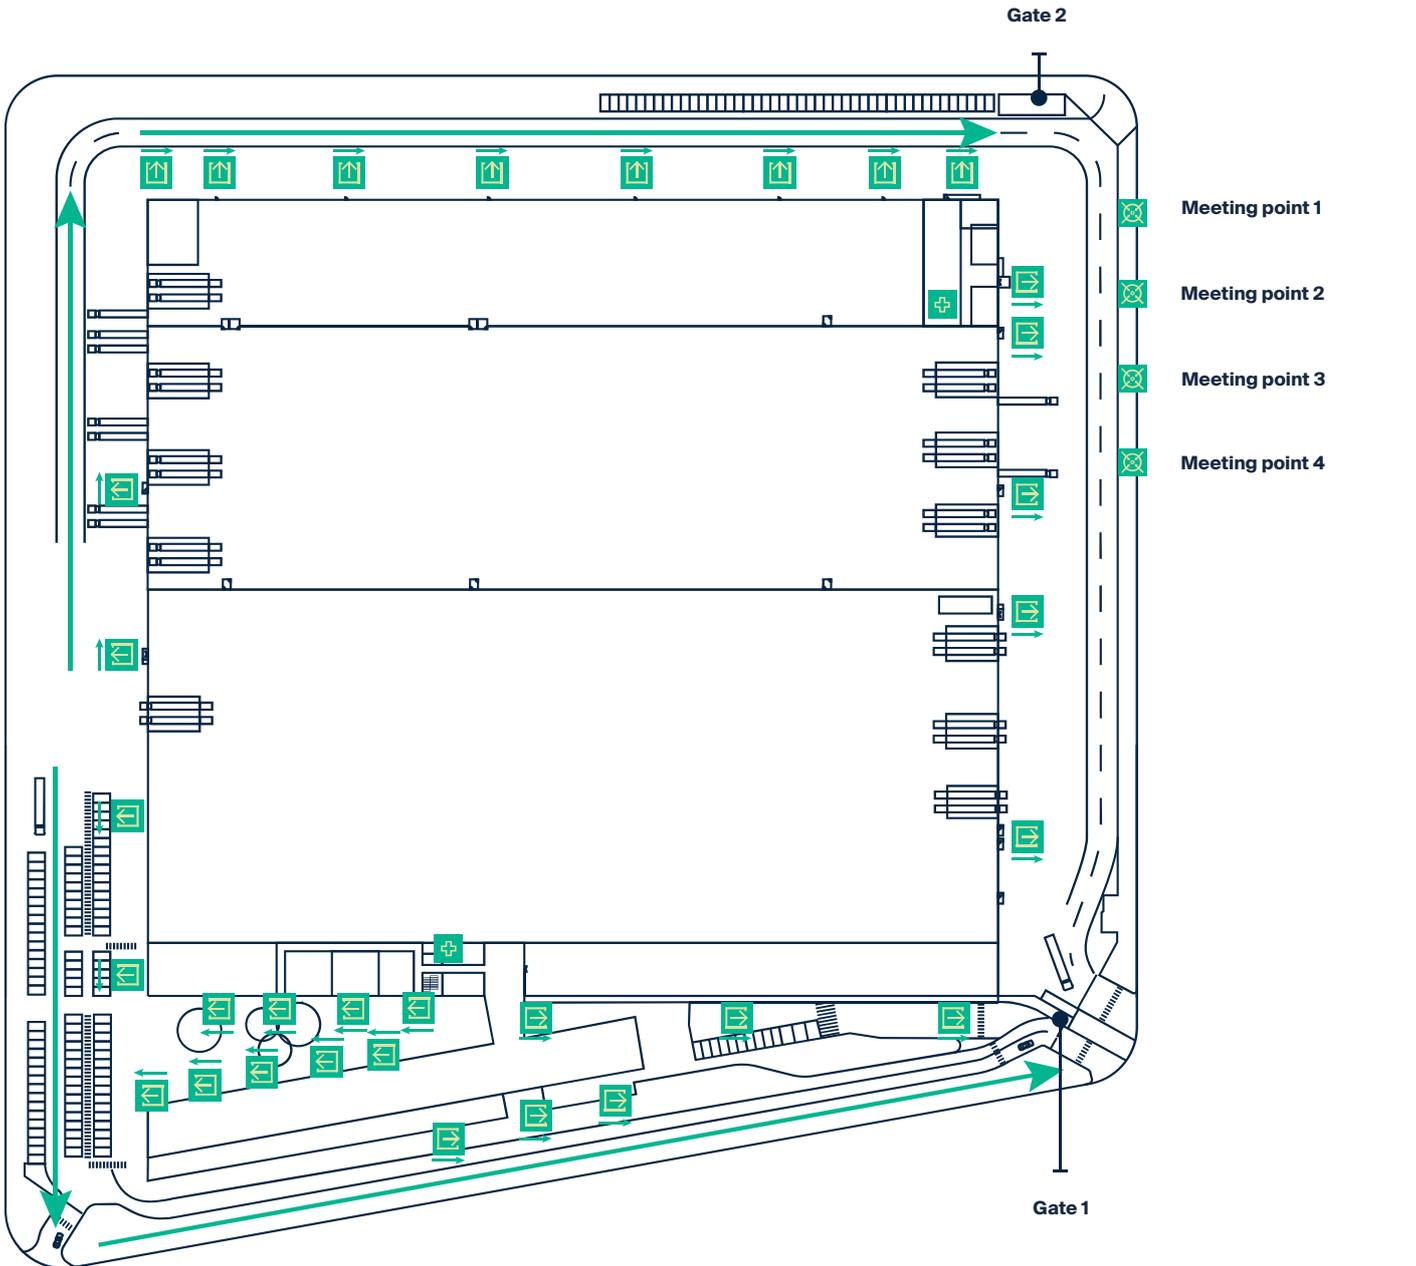

SYMBOLS	
	Emergency exits
	Medical Service
	PE personnel meeting point
	External companies meeting point
	Evacuation direction

EMERGENCY PHONE NUMBERS	
Emergency Chief 661 219 624/663 253 866	Emergencies 112
Intervention Chief 607 485 340/664 639 126	Radio Taxi 961 251 150
Lliria Hospital 962 718 800	
Intermutual de Levante Hospital 961 350 250	

